


- ① EXISTING GRADE
- ② EXISTING MANHOLE
- ③ 90° BEND
- ④ CORE DRILL MANHOLE AND FILL VOID WITH NON-SHRINK GROUT
- ⑤ COMPRESSION COUPLING
- ⑥ P.V.C. SEWER
- ⑦ CRUSHED STONE BEDDING
- ⑧ STRAP AT TEE ELBOW AND ON 4' CENTERS WITH 1/2" DIA. EXPANSION TYPE S.S. CINCH BOLTS & S.S. ANCHORS
- ⑨ \* 90° BEND RESTING ON RE-FORMED CHANNEL AND TURNED IN DIRECTION OF EXISTING SEWER FLOW
- ⑩ \* EXIST. SEWER

\* PIPE SIZE VARIES

**NOTE:**

THE CONSTRUCTION OF AN INSIDE DROP MANHOLES ONLY PERMITTED WITH PRIOR APPROVAL OF AUTHORITY.

**SECTION**

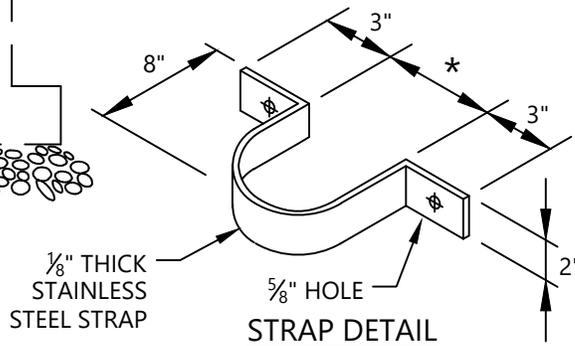

1/8" THICK  
STAINLESS  
STEEL STRAP

**STRAP DETAIL**

**NOT TO SCALE**

	<b>LEE COUNTY UTILITIES ENGINEERING</b> <small>1500 MONROE STREET FORT MYERS, FLORIDA 33901</small>	
	<b>TITLE: INSIDE MANHOLE DROP</b>	
<small>REVISION:</small> 2/11/25	<small>DETAIL NO:</small> S-11.dwg	